


PIPE DEPTH WITH DECLINING GRADE
AT EDGE OF PAVEMENT

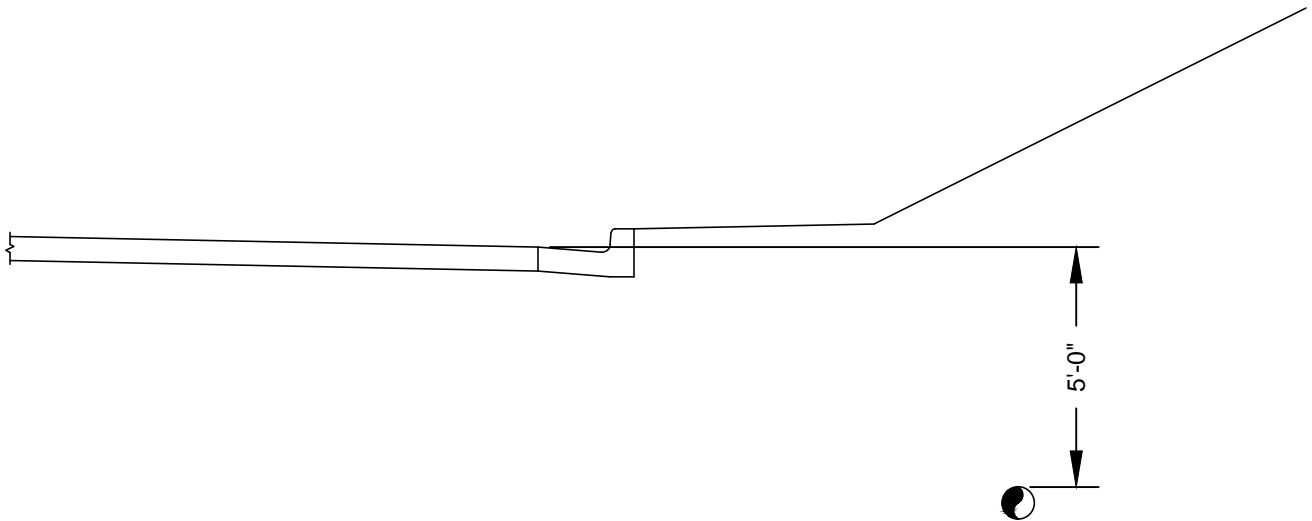

PIPE DEPTH WITH INCREASING GRADE
AT EDGE OF PAVEMENT

NOTES:

1. SANITARY SEWAGE FORCE MAINS SHALL HAVE A MINIMUM DEPTH OF COVER OF 60-INCHES UNLESS OTHERWISE APPROVED BY HCWSA.



HENRY COUNTY WATER & SEWERAGE AUTHORITY

**PIPE DEPTH AT
EDGE OF PAVEMENT**

REVISED: 01/01/2012

SCALE: N.T.S.

DETAIL NO.

S06